


Line Stainless Steel Towel Warmer (58LS)

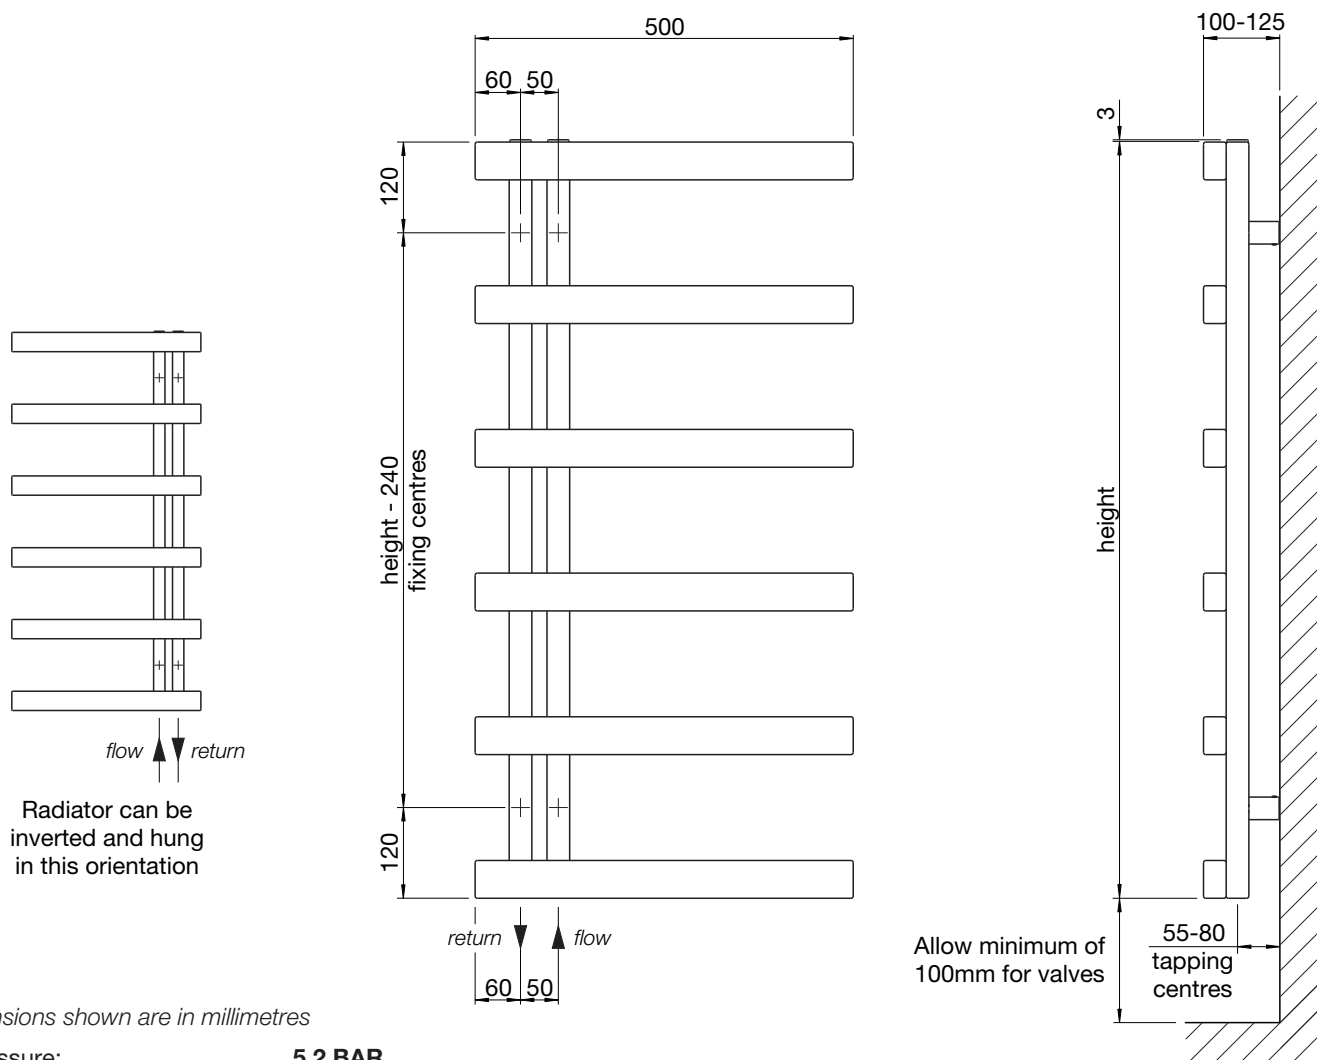

All dimensions shown are in millimetres

Test pressure: **5.2 BAR**
 Max working pressure: **4 BAR**
 Max working temperature: **90° C**
 All stainless steel construction: **30mm x 50mm x 1.2mm tubes**
30mm x 30mm x 1mm headers
 Connections: **½ inch BSP underside tapplings**

Heat output determined in accordance with EN 442
 Test Laboratory: BSRIA, Test Lab Registration No: 0480

| Model | Height ± 2mm | Width ± 2mm | Finish | Output ΔT=50K | | Output ΔT=30K | | n | Weight kg | Water Content litres |
|-------|-----------------|----------------|--------|------------------|------|------------------|-----|------|--------------|----------------------------|
| | | | | Watts | Btu | Watts | Btu | | | |
| | 1000 | 500 | mirror | 256 | 873 | 135 | 461 | 1.25 | 7.7 | 5.2 |
| | 1380 | 500 | | 332 | 1133 | 171 | 583 | 1.30 | 10.3 | 7.2 |
| | 1760 | 500 | | 417 | 1423 | 221 | 754 | 1.24 | 12.4 | 9.1 |

Issue 1.1



Tel: 01722 415000
 sales@livinghouse.co.uk
 www.livinghouse.co.uk

Line Stainless Steel Towel Warmer (58LS)



Tools & Material Required

Suitable valves
PTFE tape
Silicone thread sealant
Tape measure
Allen key - 13mm & 12mm (when installing Zehnder valves)
Spanner - 13mm & 14mm
Screwdriver - crosshead & flathead
Electric drill
Masonry drill bit
Spirit level
Stepladder (for taller radiators)

| Key | Component | Qty |
|-----|----------------------------------|-----|
| A | Air Vent - 1/2" | 2 |
| B | Cover Cap | 2 |
| C | Wall Plug | 4 |
| D | Bracket | 4 |
| E | Screw - Rnd Head, 6mm dia x 50mm | 4 |
| F | Grub Screw | 4 |
| G | Allen Key | 1 |

Assembly Instructions

*Sufficient PTFE tape must be applied to valve-tail threads prior to their installation.
Silicone thread sealant should be applied to all threaded components manufactured with 'O-rings'.*

Fit valve tails, using correct size Allen key.

Fit air vents (A) & cover caps (B) to radiator.

Accurately mark out bracket holes on wall using spirit level.

Drill four 8mm diameter holes to a minimum depth of 60mm & insert wall plugs (C).

Screw brackets (D) into wall plugs (C) with 6mm diameter x 50mm screws (E).

Slide boss on radiator into bracket (D) and secure in position by tightening grub screw (F) with allen key (G).

Check the radiator is mounted perfectly vertical to minimise the risk of trapping air.

Plumb radiator to heating circuit with flow opposite air vent. Open both air vents (A) at the same time when bleeding radiator.

Air vent is recessed so flathead screwdriver must be used to vent radiator.

This radiator should be installed onto a central heating system that has been cleaned/flushed and contains water treatment and inhibitors in accordance with BS7593.

